


Ventilation Guidelines: Wine-mate Ducted System Units

Your cellar must be properly insulated and vapor sealed in order for these units to function properly. Place the unit in a properly ventilated location. If it is not, heat exhausted by the condensing unit will build up and the cooling system will not operate properly.

Model Number	
WM-4500DS	Leave minimum 5 feet clearance for hot air exhaust and leave minimum 1 foot clearance for the ambient fresh air intake.
WM-6500DS	Supply air flow shall be unobstructed for minimum 12" for a direct blow installation; leave 2" clearance for a deflector installation; return air shall be unobstructed for minimum 6".
WM-8500DS	Please consult your unit's manual for more detailed clearance guidelines.

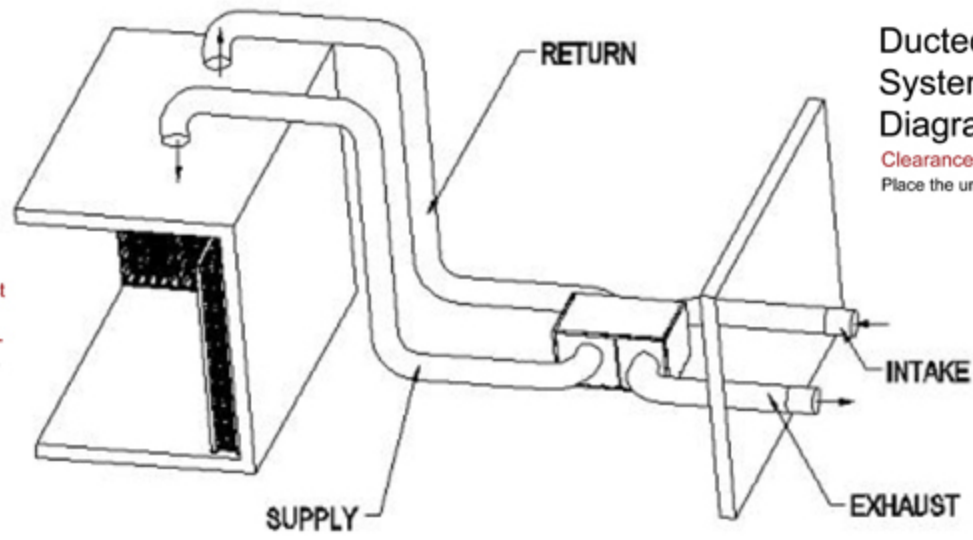

Ducted System Diagram

Clearance Guidelines
Place the unit in a properly ventilated location.

*air supply shall be unobstructed minimum 12" for direct blow installation; leave a 2" clearance for a deflector installation; air return shall be unobstructed minimum 6".

*allow for a minimum of 5ft clearance for the hot air exhaust, minimum 1ft clearance for the ambient fresh air intake.