


### Ventilation Guidelines: Wine-mate Ducted System Units

Your cellar must be properly insulated and vapor sealed in order for these units to function properly. Place the unit in a properly ventilated location. If it is not, heat exhausted by the condensing unit will build up and the cooling system will not operate properly.

<b>Model Number</b>	
<b>WM-4500DS</b>	Leave minimum 5 feet clearance for hot air exhaust and leave minimum 1 foot clearance for the ambient fresh air intake.
<b>WM-6500DS</b>	Supply air flow shall be unobstructed for minimum 12" for a direct blow installation; leave 2" clearance for a deflector installation; return air shall be unobstructed for minimum 6".
<b>WM-8500DS</b>	Please consult your unit's manual for more detailed clearance guidelines.

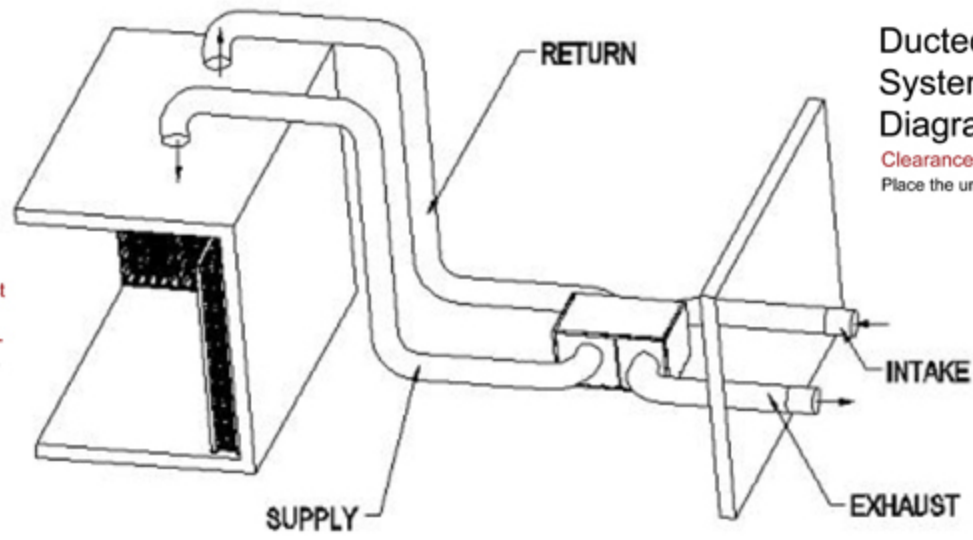

**Ducted System Diagram**

Clearance Guidelines  
Place the unit in a properly ventilated location.

\*air supply shall be unobstructed minimum 12" for direct blow installation; leave a 2" clearance for a deflector installation; air return shall be unobstructed minimum 6".

\*allow for a minimum of 5ft clearance for the hot air exhaust, minimum 1ft clearance for the ambient fresh air intake.